

**WESKUS DISTRIKSMUNISIPALITEIT
WEST COAST DISTRICT MUNICIPALITY**



**REQUEST FOR FORMAL WRITTEN PRICE QUOTATIONS: SERVICE AND REPAIR OF
TIGER RING MAIN UNITS FOR WATER PURIFICATION**

QUOTATION REFERENCE: 6/5/2/414

Kindly furnish us with a written quotation as per attached specifications:

Specification enquiries can be directed to **Mr EJ Carstens at 022 433 2352**

The quotation must be clearly endorsed/marked with **Reference number: 6/5/2/414 – Repairs and maintenance** and submitted on the letterhead of your business and can either be faxed, e-mailed or delivered by hand not later than **12:00, Tuesday, 02 November 2021** to:

Supply Chain Management Office, West Coast District Municipality, 58 Long Street,
Moorreesburg . Fax: 086 652 7690 or E-mail to scm@wcdm.co.za

The following conditions will apply:

- Price(s) quoted must be valid for at least thirty (30) days from date of your offer.
- Price(s) quoted must be firm and must be inclusive of VAT.
- A firm delivery period must be indicated.
- Please note that the attachment limit per e-mail is 8 mega bites (MB). Service providers are free to divide emails into smaller attachments. Only fully submitted quotations will be considered at date and time of closing.
- It is expected of all prospective service providers who are not yet registered on the Central Supplier Database (**CSD**) to register without delay.
- The Municipality reserves the right not to award formal written price quotations to prospective suppliers who are not registered on the Database (CSD). Service providers to submit proof of registration on the CSD with quotation submissions
- The prospective Service providers attention is drawn to the following list of forms and other documents that need to be completed and submitted with his/her quotation documents:
 - a) Declaration of Interest (**MBD4**)
 - b) Declaration in terms of Clause 112(1)(I) of the Municipal Finance Act, Act No 56 of 2003 (**MBD8**).

- c) **Bidder should provide a valid tax clearance certificate or tax compliance status PIN to enable the municipality to verify the bidder tax clearance status.**
 - d) Proof of registration for VAT (if applicable)
 - e) Certificate of independent determination (MBD9)
 - f) A original and valid B-BBEE Verification Certificate or certified copies
- In terms of Clause 112(1)(l) of the Municipal Finance Management Act, Act No 56 of 2003, persons who were convicted for fraud or corruption or who wilfully neglected, reneged on or failed to comply with a government tender during the past 5 years, or whose tax matters are not cleared by the South African Revenue Services may not participate in the tendering process and the Bidder shall submit a sworn statement, a declaration of bidder's past Supply Chain Management practices to this effect (MBD8).
 - **The quotation must be completed in black ink and any corrections to the official quotation from must be made in Black ink and signed by the bidder. Any quotation received with correction fluid (Tippex) corrections shall be disqualified.**
 - Tenders that are not clearly endorsed, or which are received after the closing time and date will not be considered.
 - The bid documents should be carefully completed and no errors will be condoned after bids have been opened.
 - The fact and action of handing in a quotation to the Council is accepted as a contract between the Council and the Bidder whereby such a quotation remains valid and available for a period of thirty (30) days, calculated from the closing date as advertised for the quotation, for acceptance or non-acceptance by the Council. The bidder undertakes not to withdraw, or alter, the quotation during this period.
 - Notice of acceptance of the quotation by the Municipal Manager will be considered as a binding contract with effect from the date of such notice.
 - The Council does not bind itself to accept the lowest or any, quotation and reserves the right to accept any quotation in whole or part.
 - **The bidder will be liable to take out forward cover to barricade him/her against fluctuations of the exchange rate in the event of importing any component, related to the quotation, from any country dealing in currency other than that of South Africa.**
 - Any person, having a kinship with persons in the service of the state, including a blood relationship, may make an offer in terms of this invitation to bid. In view of possible allegations of favouritism, should the resulting bid, or part thereof, be awarded to persons connected with or related to persons in service of the state, it is required that the bidder or their authorised representative declare their position in relation to the evaluating/adjudicating authority and/or take an oath declaring his/her interest. A declaration of interest form must be completed and submitted to this effect (MBD4)
 - A certificate of independent determination (MBD9) must be completed and submitted with your quotation. This is to inform bidders about the illegality of bid rigging and the penalties

applicable to enterprises found to have engaged in such practices and the possible investigations and imposition of administrative penalties by the Competition Commission.

- The bid of any person who canvasses or solicits, or causes to be canvassed or solicited, the support of any person employed by or in the service of the Employer or of the Agent, Consulting Engineer in favour of his/her offer will not be considered.
- This quotation will be evaluated in terms of the 80/20 preference point system as prescribed in the Preferential Procurement Regulations of 2017. The Preference Points claim form in terms of the Preferential Procurement Regulations 2017, 80/20 (**MBD6.1**) must be scrutinized, completed and submitted together with your quotation.
- Bidders wishing to benefit from it must submit a original and valid B-BBEE Verification Certificate or certified copies thereof from a Verification Agency accredited by the South African Accreditation System (SANAS) or sworn affidavit as prescribed by Department of Trade and Industry together with the quotation. Failure to submit the abovementioned will result in the bidder only receiving the applicable points for price. The Municipality reserves the right to request proof of empowerment.
- A valid tax clearance certificate, issued by the South African Revenue Services (SARS), must accompany your quotation or the bidder should provide the PIN that can be shared with third parties to enable third parties to verify or confirm the tax compliance status of the bidder to whom the PIN belongs. Official purchase order will only be placed against provision of tax clearance certificate or master registration number or tax compliance status PIN.
- Transaction will be subject to General Conditions of Contract (GCC).
- The Preference Points claim form in terms of the Preferential Procurement Regulations 2017, 80/20, Tax Clearance Certificate Requirements, SARS Application for Tax Clearance Certificate, Declaration of bidder's Past Supply Chain Management practices, Certificate of Independent Bid Determination, Certificate for Local Production and Content, General Conditions of Contract and the Declaration of Interest can be downloaded from : www.westcoastdm.co.za/tenders
- The successful provider will be the one scoring the highest points.

NB: No quotations will be considered from persons in the service of the state

Failure to comply with these conditions may invalidate your offer.

Yours faithfully



SUPPLY CHAIN MANAGEMENT OFFICE
TEL: 022 433 8400
E-MAIL: scm@wcdm.co.za
22 October 2021

SPESIFIKASIE / SPECIFICATION

<u>Besonderhede/Description</u>	<u>Hoeveelheid / Quantity</u>
<p>Service and repairs:</p> <p>Tiger Ring Main units Swartland Pump Station.</p> <ol style="list-style-type: none">1) All seals to be checked and leaks to be repaired2) Oil to be checked and filled to unit specification.3) Transformers 1 & 2 the checked and oil to be filled to specification of transformer, prior to filling oil samples to be taken. <p>Tiger Ring Main Units Withoogte Water Works</p> <ol style="list-style-type: none">1) All seals to be checked and leaks to be repaired2) Oil to be checked and filled to unit specification <p>NB: Both Stations to be done in a day each (2 days) all oils should be of virgin type transformer oils and not regenerated oils. +- 2 drums</p> <p>Data sheets attached:</p>	<p>2 units</p> <p>2 units</p>
<p>Enquiries can be directed to EJ Carstens – 022 433 2352</p>	

NEI TRANSFORMERS


CAPE TOWN DIVISION

TRANSFORMER TO



S.A.B.S. 780

OUTPUT kVA	1000
VOLTS AT NO LOAD	PRIMARY 11000 SECONDARY 420
AMPERES	PRIMARY 52,6 SECONDARY 1375
PHASES	3
TYPE OF COOLING	O.N.A.N.
FREQUENCY	50 HZ
IMPEDANCE VOLTS	0.05 %
VECTOR GROUP	Dyn 11
IMPULSE LEVEL	75 kV
CORE & WINDINGS	955 kg
TOTAL WEIGHT	1795 kg
OIL QUANTITY	485 litres
DIAGRAM DRG.No.	8/30410/A4 Rev.2
SERIAL No.	4R2296
ORDER NO.	
YEAR OF MANUFACTURE	2000

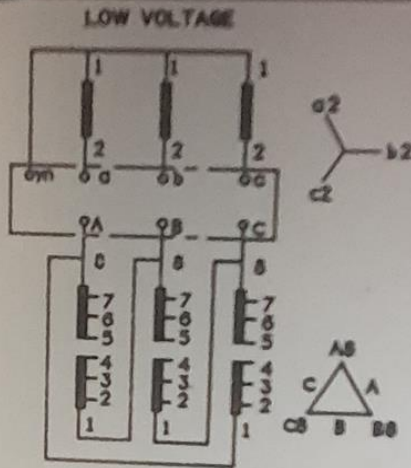

SWITCH POS No.	1	2	3	4	5
% H.V. VOLTS	105	102,5	100	97,5	95

" OIL CONTAINS LESS THAN 2mg/kg pcb "

WARNING

VENTILATE TANK INTERIOR BEFORE REMOVING COVER

SL Tfr 1

ON RECEIPT THE FOLLOWING MUST BE CHECKED

- CHECK FOR TRANSPORT DAMAGE
- CHECK FOR ANY OIL LEAKS

ON INSTALLATION

ALTHOUGH ALL GASKET JOINTS ARE TORQUED IN THE FACTORY IT IS VERY IMPORTANT THAT ALL NUTS BE CHECKED ON SITE.

(TIGHTEN COVER NUTS BY "ONE FLAT" WHERE APPLICABLE)
(TIGHTEN INSULATOR NUTS & LOCK NUTS BY "ONE FLAT")

- FIT SILICA GEL BREATHER ON TRANSFORMERS EQUIPPED WITH CONSERVATORS (FREE BREATHING UNITS)
- CHECK TAP SWITCH POSITION
- TOUCH-UP PAINT WORK

CONNECTION TO INSULATORS

ENSURE THAT CABLES OR BUSBARS CONNECTED TO THE INSULATORS DO NOT CAUSE ANY MECHANICAL STRESS.

Power Engineers

ELIOT AVENUE EPPING CAPE TOWN




TRANSFORMER TO



S.A.B.S. 780

OUTPUT kVA	1250
VOLTS AT NO LOAD	PRIMARY 11500
	SECONDARY 420
AMPERES	PRIMARY 62.8
	SECONDARY 1718
PHASES	3
TYPE OF COOLING	O.N.A.N.
FREQUENCY	HZ 50
IMPEDANCE VOLTS	5.95 %
VECTOR GROUP	Dyn 11
IMPULSE LEVEL	kV 75
CORE & WINDINGS	kG 1780
TOTAL WEIGHT	kG 3600
OIL QUANTITY	litres 860
DIAGRAM DRG.No.	8/30506/A4 Rev.1
SERIAL No.	20503701/01
ORDER NO.	
YEAR OF MANUFACTURE	2003

LOW VOLTAGE

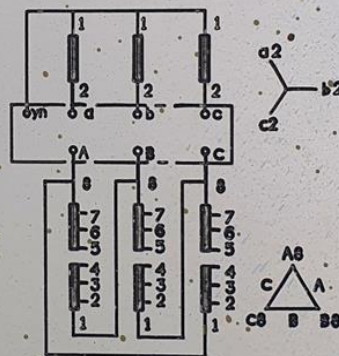

HIGH VOLTAGE

SWITCH POS No.	1	2	3	4	5
% H.V. VOLTS	105	102.5	100	97.5	95

WARNING

VENTILATE TANK INTERIOR BEFORE REMOVING COVER

SL Tfr 2



HAWKER SIDDELEY SWITCHGEAR SOUTH AFRICA - SUID AFRICA

TIGER

Tiger Data

TYPE REFERENCE
Tipe Verwysing **NX3F**
SERIAL No.
REEKS Nr. **FG4536/2**
YEAR OF MANUFACTURE
VERVAARDIGINGSJAAR **2003**
WEIGHT WITHOUT OIL AND COMPOUND **270 kg**
GEWIG SONDER OLIE OF KABELKASMENGSEL
OIL CONTENT **140** LITRES/LITERS
OLIE INHOUD

SYSTEM HIGHEST VOLTAGE **12 kV**
HOOGSTE NETSPANNING
IMPULSE - VOLTAGE WITHSTAND LEVEL **95 kV**
IMPULSWEERSTANDSSPANNING
FREQUENCY **50 Hz**
FREKWENSIE

RATINGS - KENWAARDES

	BUSBARS GELEISTAMME	SWITCHES SKAKELAARS	FUSE-SWITCH SEKERINGSKAKEL- AAR
NORMAL CURRENT A NORMALE STROOM	630	630	125
3 SECOND SHORT-TIME CURRENT kA 3 SEKONDE KORTTERMYNSTROOM	20	20	-
PEAK MAKING CURRENT kA TOPSLUITSTROOM	50	50	-
EARTH SWITCH 3 SECOND SHORT- TIME CURRENT kA AARDINGSKAKELAAR 3 SEKONDE KORTTERMYNSTROOM		20	2,1
EARTH SWITCH PEAK MAKING CURRENT TOPSLUITSTROOM VAN kA AARDINGSKAKELAAR		50	5,4

WHEN FITTED WITH FUSE-LINKS TO BS 2692 THE COMPLETE EQUIPMENT HAS A
SHORT-CIRCUIT RATING EQUIVALENT TO 400 MVA AT 12 kV.

WANNEER SEKERINGS VOLGENS BS 2692 GEMONTEER WORD HET DIE TOERUSTING IN
KORTSLUITINGSKENWAARDE GELYKSTAANDE AAN 400 MVA TEEN 12 kV.



SL Tigers