


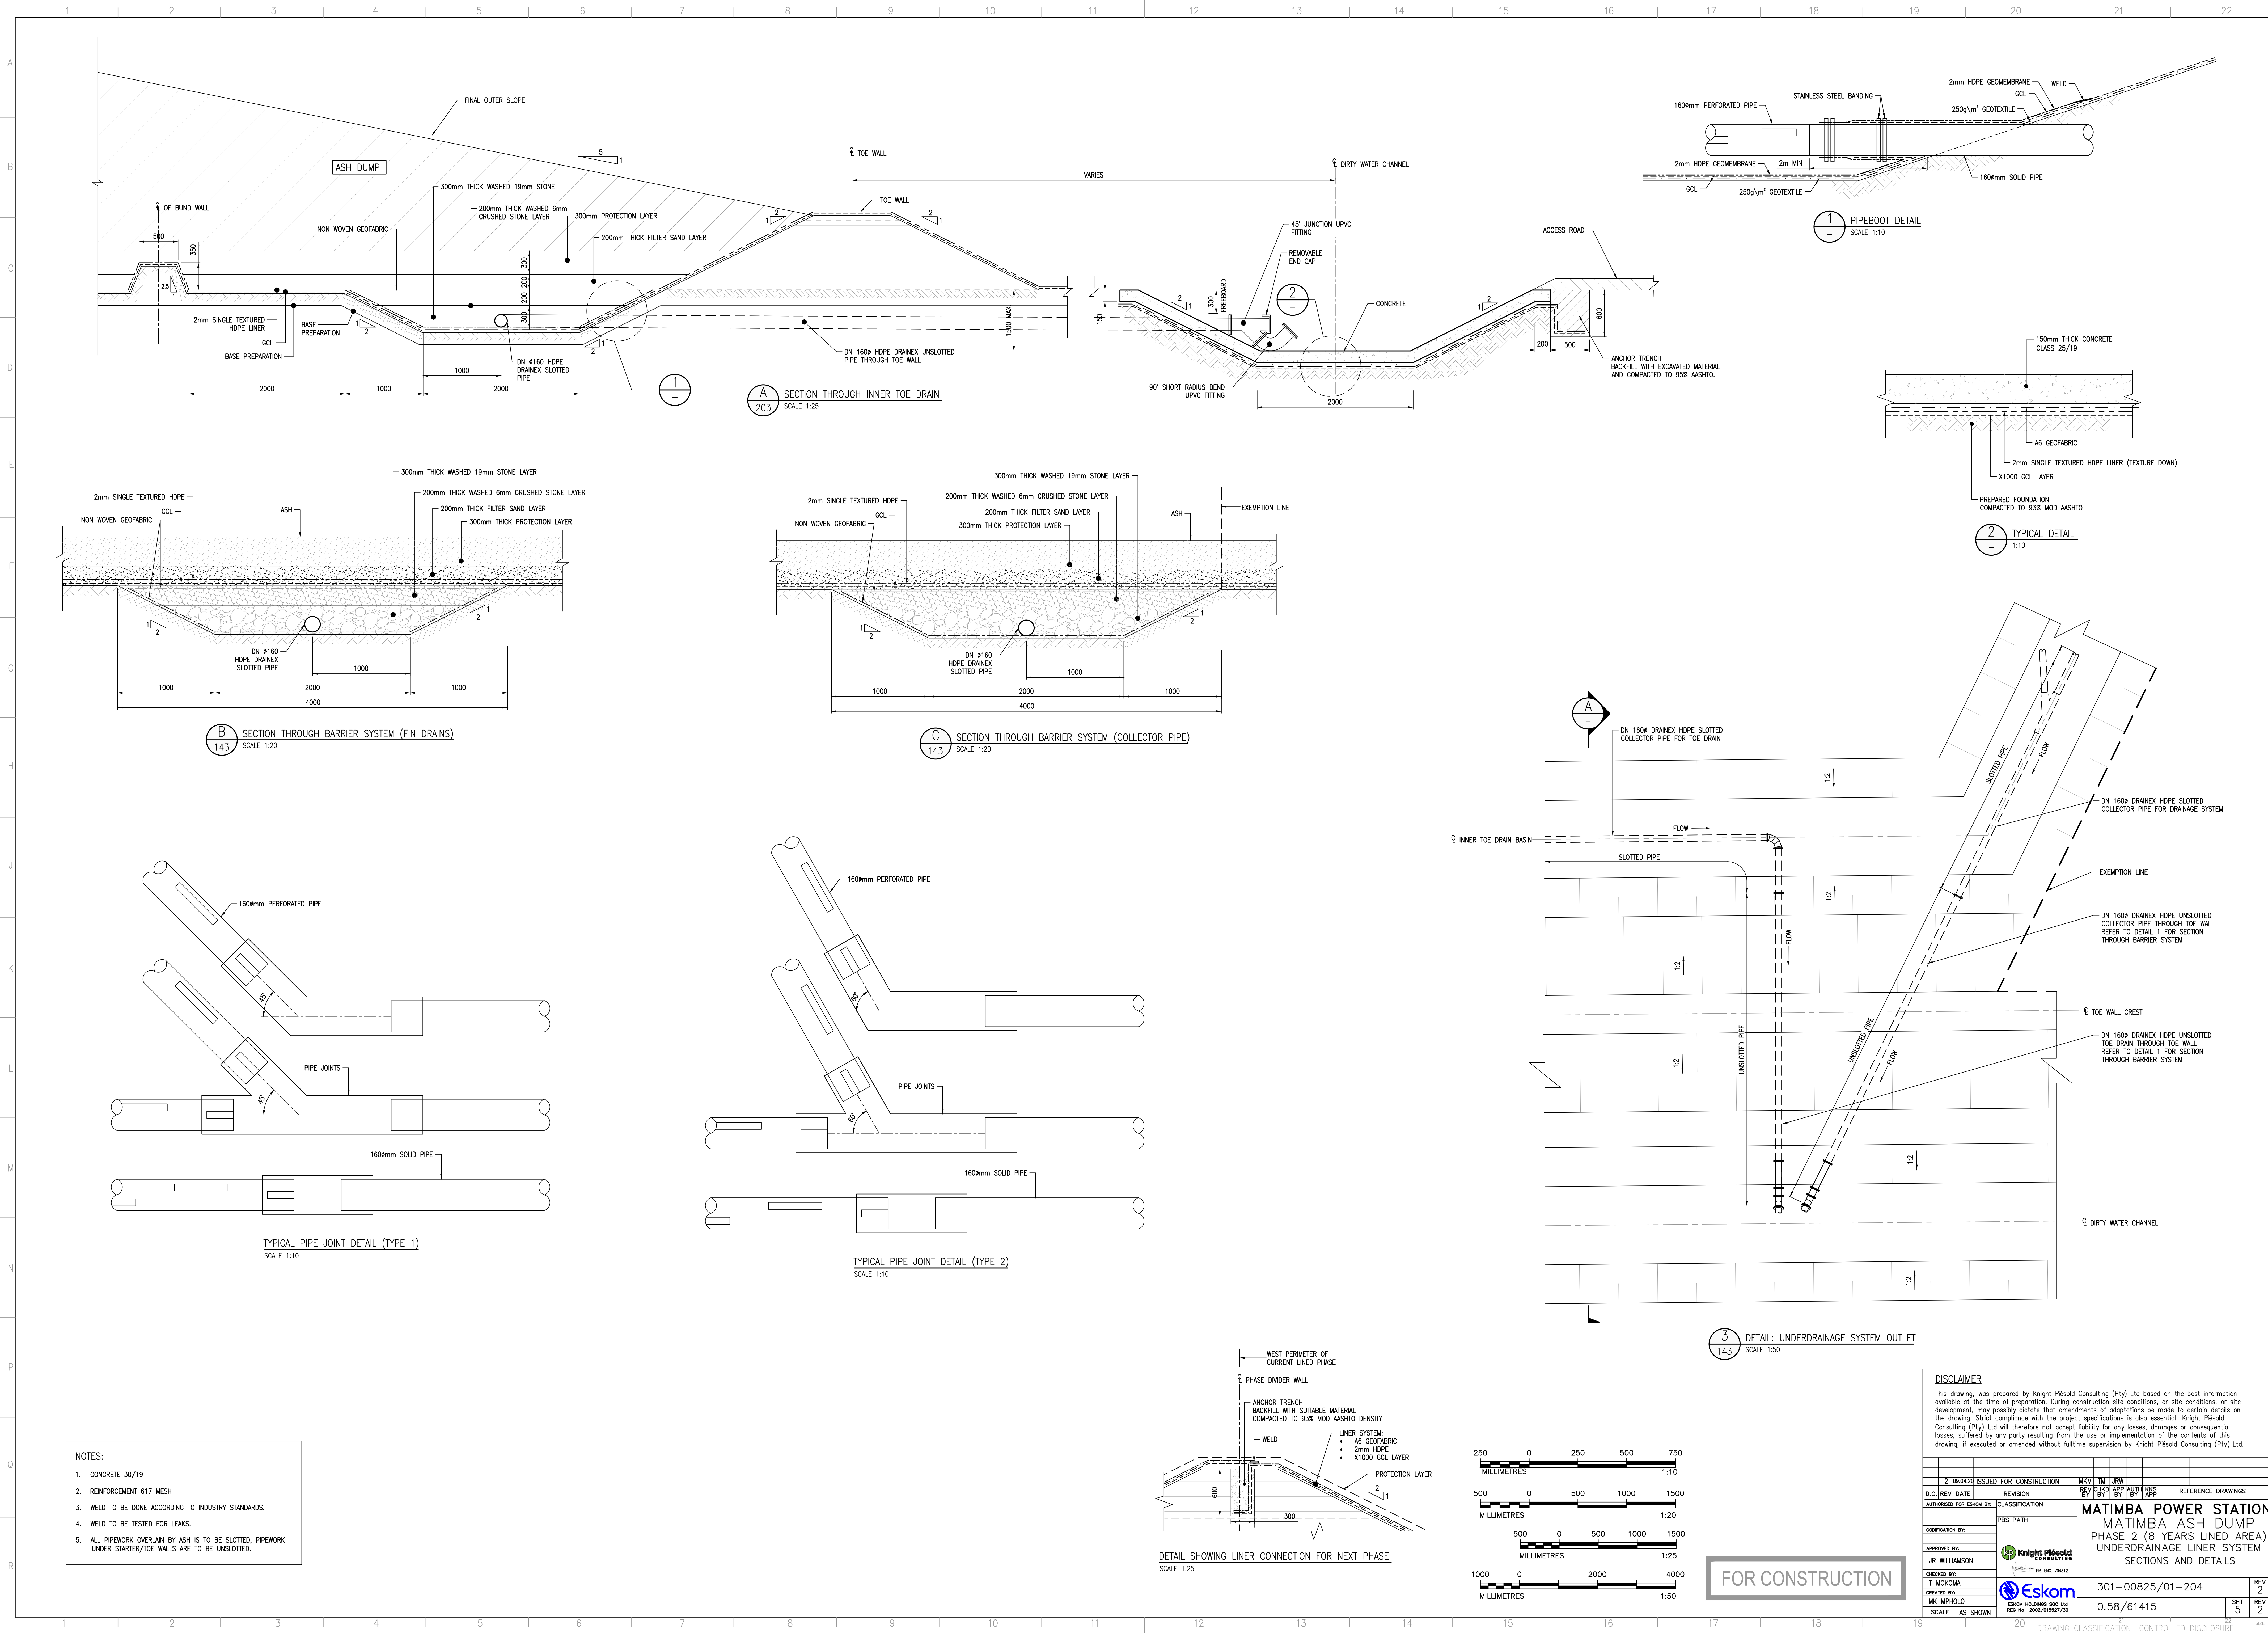

- NOTES:**
1. CONCRETE 30/19
 2. REINFORCEMENT 617 MESH
 3. WELD TO BE DONE ACCORDING TO INDUSTRY STANDARDS.
 4. WELD TO BE TESTED FOR LEAKS.
 5. ALL PIPEWORK OVERLAIN BY ASH IS TO BE SLOTTED, PIPEWORK UNDER STARTER/TOE WALLS ARE TO BE UNSLOTTED.

DISCLAIMER
This drawing was prepared by Knight Piesold Consulting (Pty) Ltd based on the best information available at the time of preparation. During construction site conditions, or site conditions, or site development, may possibly dictate that amendments or adaptations be made to certain details on the drawing. Strict compliance with the project specifications is also essential. Knight Piesold Consulting (Pty) Ltd will therefore not accept liability for any losses, damages or consequential losses, suffered by any party resulting from the use or implementation of the contents of this drawing, if executed or amended without fulltime supervision by Knight Piesold Consulting (Pty) Ltd.

2	29.04.20	ISSUED FOR CONSTRUCTION	MMK	TM	JRW					
0	REV. DATE	REVISION	REV	CHKD	APP	AUTH	AKS	REFERENCE DRAWINGS		
AUTHORISED FOR ESKOM BY:		CLASSIFICATION	PERS PATH							
COORDINATION BY:										
APPROVED BY:										
JRW WILLIAMSON			Knight Plesco Engineering & Construction P.O. Box 740151 JOHANNESBURG 2001							
CREATED BY:										
1. MOKOMIA										
CREATED BY:										
MK. MPHOLLO			ESKOM HOLDINGS SOC. LIM REG. NO. 2002/015037/30							
SCALE		AS SHOWN		0.58/61415		SHT 5				

FOR CONSTRUCTION